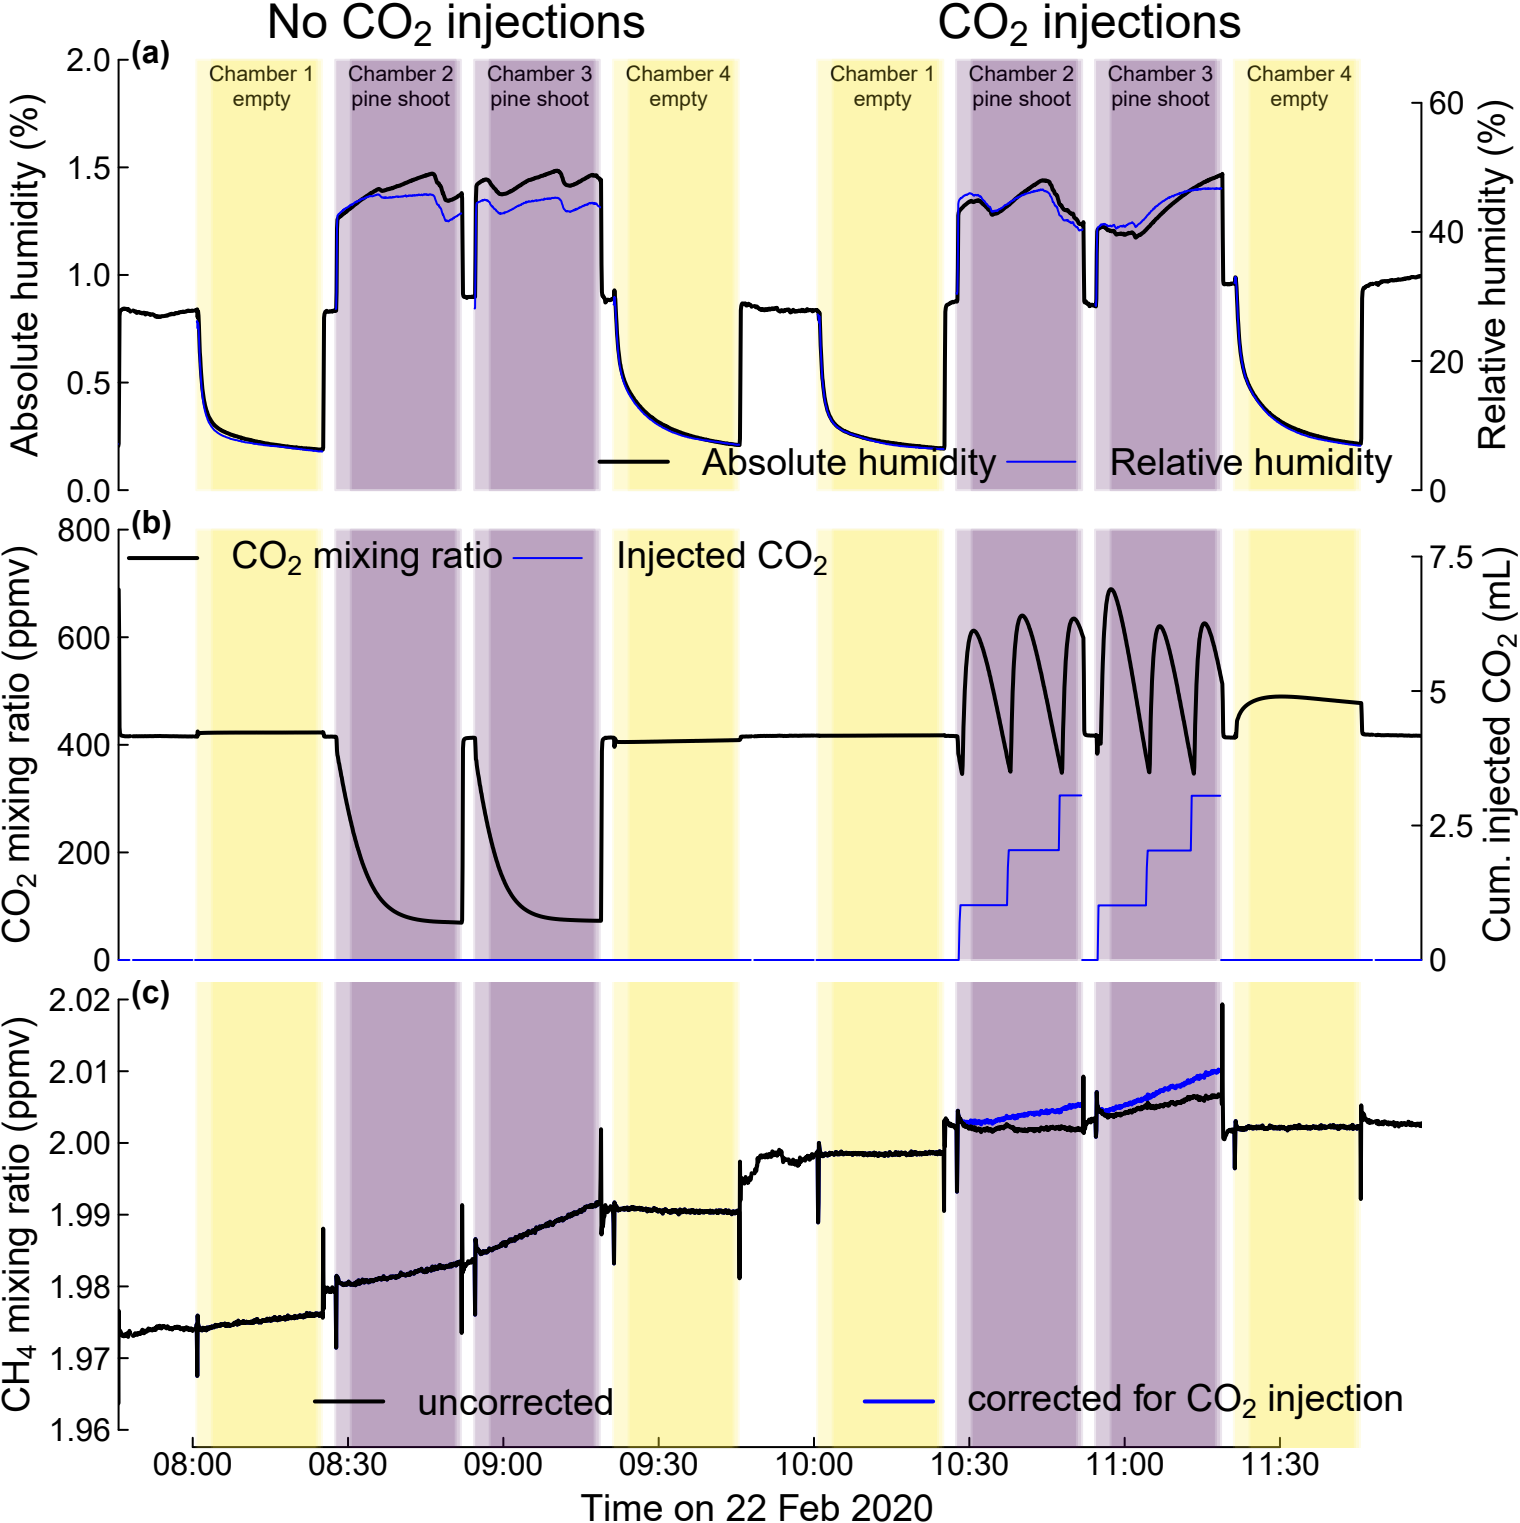
No CO_2 injections
CO_2 injections
(a)
Chamber 1 empty
Chamber 2 pine shoot
Chamber 3 pine shoot
Chamber 4 empty
Absolute humidity (%)
Relative humidity (%)
Absolute humidity
Relative humidity
(b)
CO_2 mixing ratio
Injected CO_2
CO_2 mixing ratio (ppmv)
Cum. injected CO_2 (mL)
(c)
CH_4 mixing ratio (ppmv)
uncorrected
corrected for CO_2 injection
08:00
08:30
09:00
09:30
10:00
10:30
11:00
11:30
Time on 22 Feb 2020