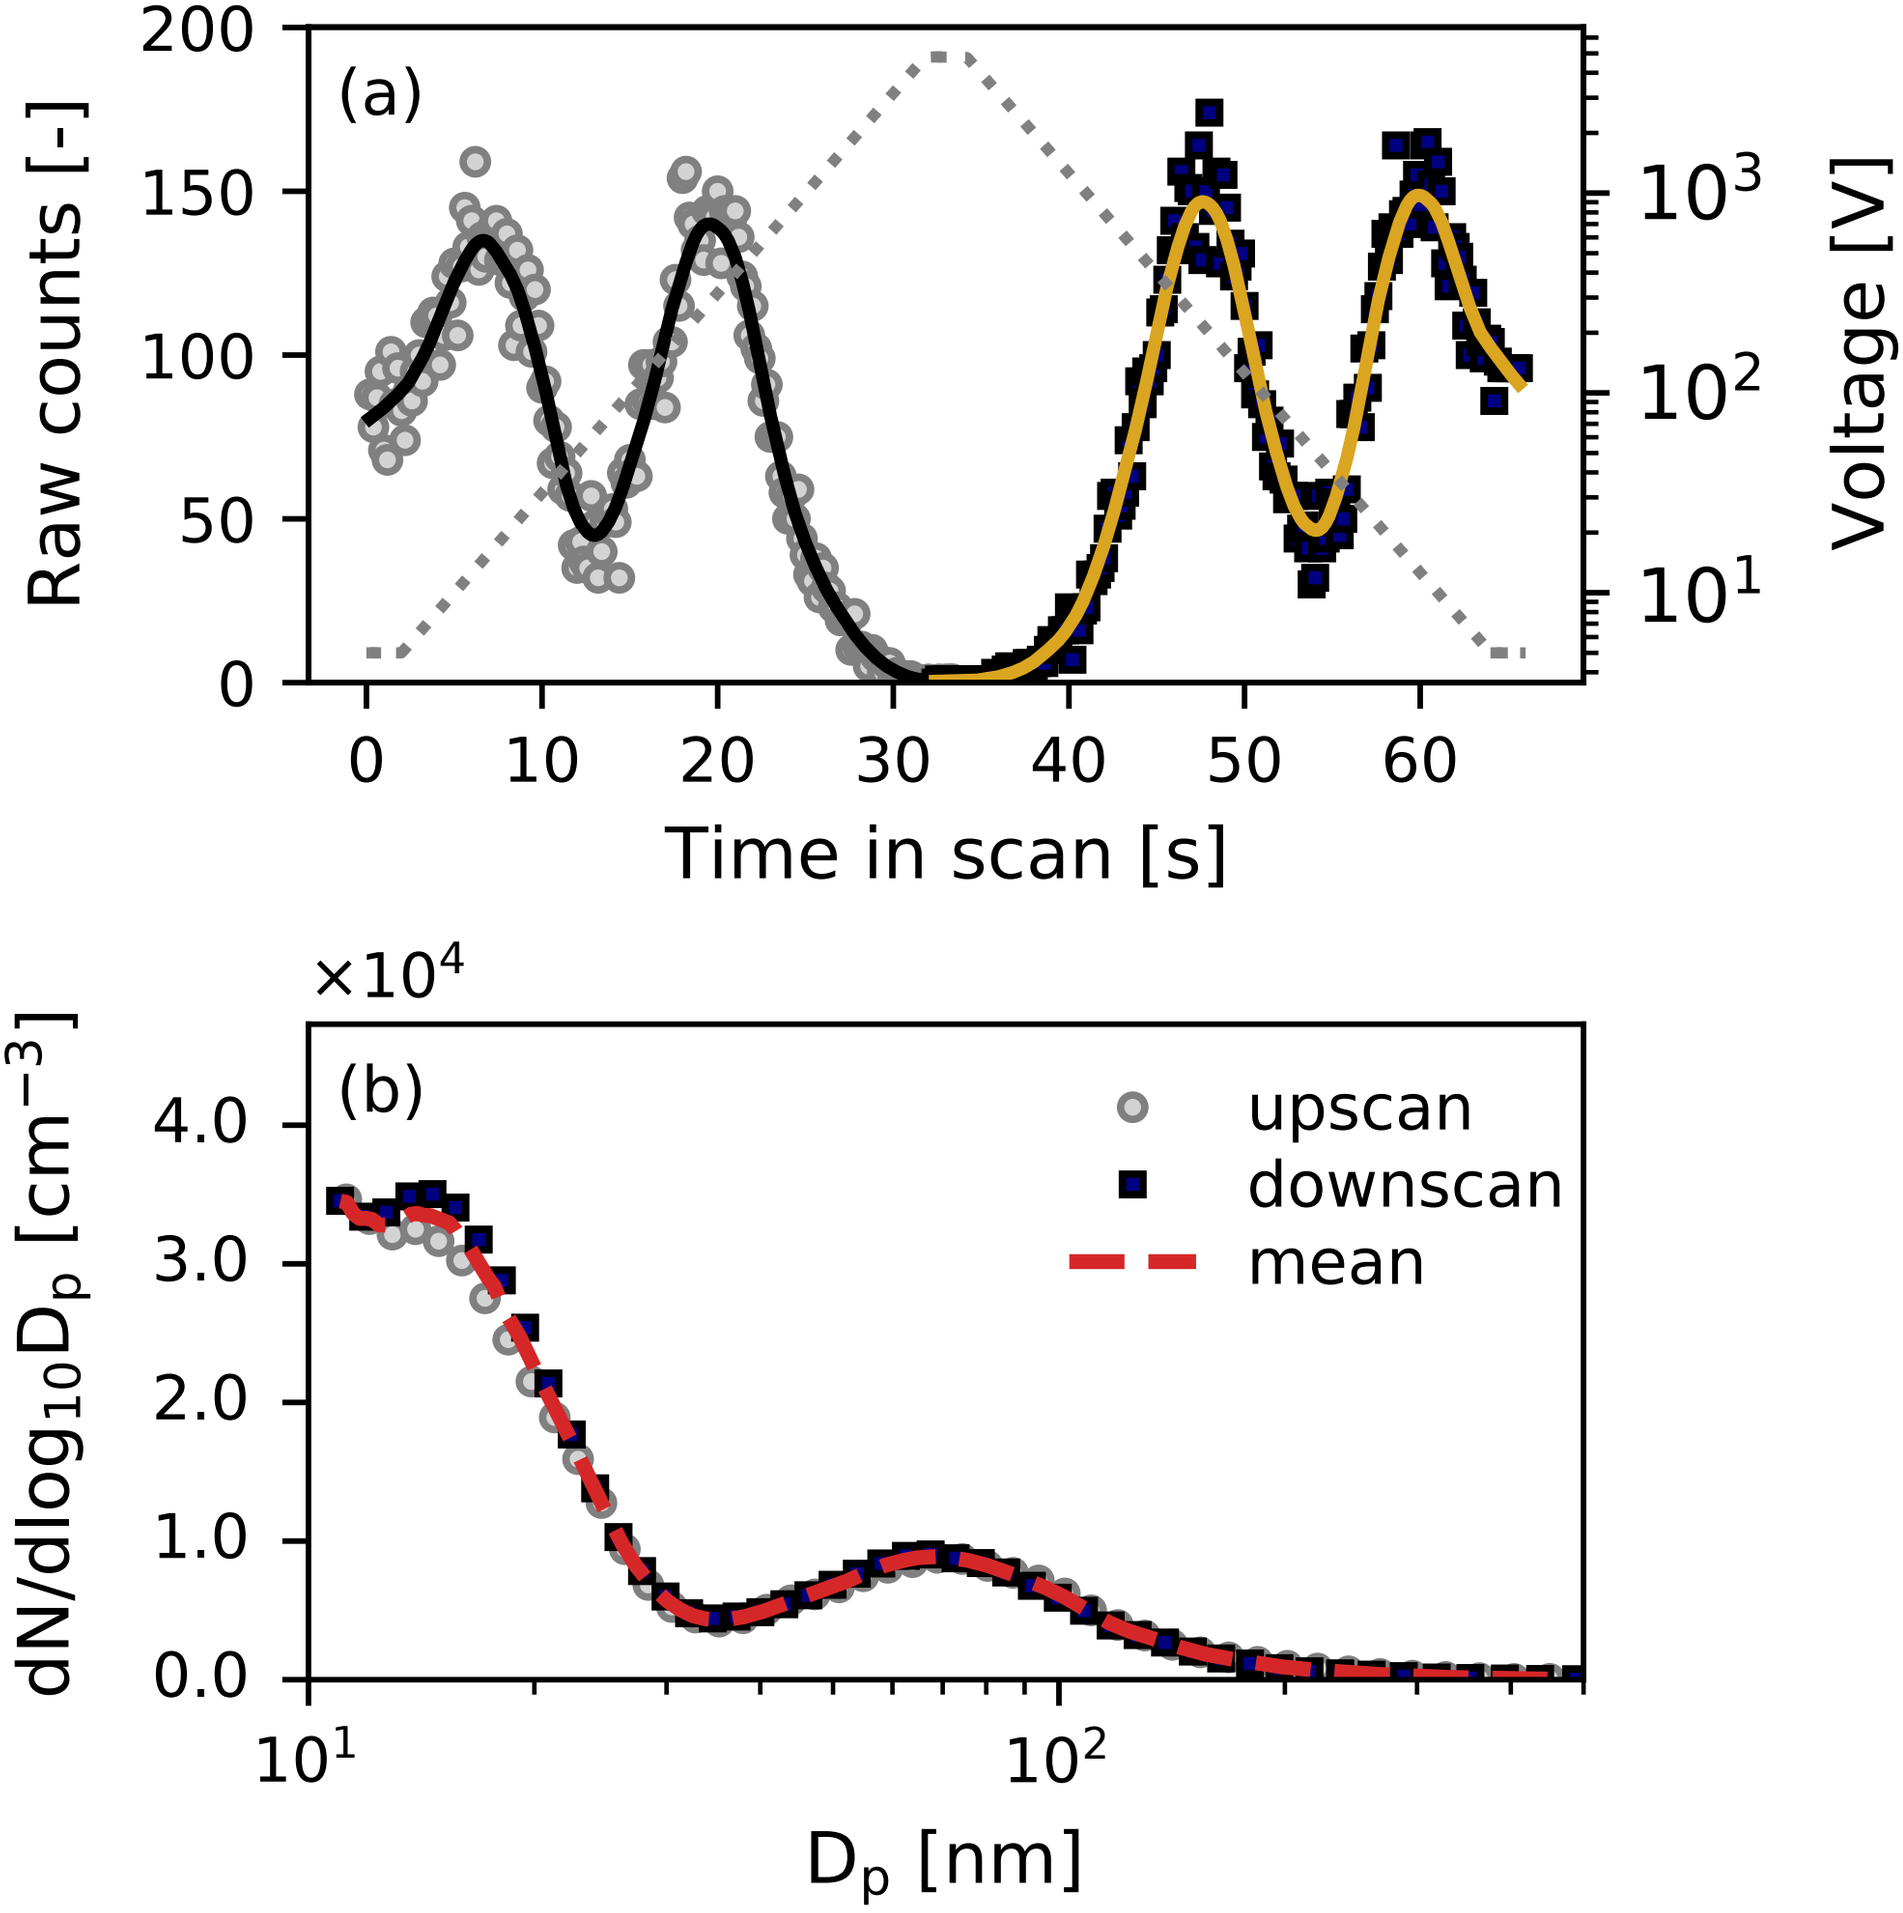
(a)
Raw counts [-]
Voltage [V]
Time in scan [s]
(b)
×10^4
upscan
downscan
mean
dN/dlog10Dp [cm^-3]
Dp [nm]