

An Instrument for Direct Measurement of Emissions: Cooling Tower Example

Christopher D. Wallis¹, Mason D. Leandro², Patrick Y. Chuang², Anthony S. Wexler^{1,3}

¹Air Quality Research Center, University of California, Davis, CA, 95616, USA

5 ²Department of Earth and Planetary Sciences, University of California, Santa Cruz, CA, 95064, USA

³Departments of Mechanical and Aerospace Engineering, Civil and Environmental Engineering, and Land, Air, and Water Resources, University of California, Davis, CA, 95616, USA

Correspondence to: Christopher Wallis (cdwallis@ucdavis.edu)

Abstract. Measuring emissions from stacks is challenging due to accessibility and safety concerns, and requires techniques to address a broad range of conditions and measurement challenges. One way to facilitate such measurements is to build an instrument package and then use a crane to hold the package over the emissions source. Here we describe such an instrument package that is used to characterize both wet droplet and dried aerosol emissions from cooling tower spray drift. In this application, the instrument package characterizes the velocity, size distribution and concentration of the wet droplet emissions and the mass concentration and elemental composition of the dried PM_{2.5} and PM₁₀ emissions. Subsequent papers will present and analyze the wet and dried emissions from individual towers.

20 **1 Introduction**

Cooling towers are used in a wide range of applications to dissipate waste heat to the environment. Wet cooling towers rely on the interaction between ambient air and cooling water to remove waste heat through evaporation. The interface between air and water results in some emission of liquid droplets, termed “spray drift.” Drift emissions result in the release of aerosolized materials, which may result in undesirable consequences in terms of respirable particle emissions, mineral deposition in nearby areas, and biological concerns such as the spread of legionella (Golay et al., 1986; Lucas et al., 2012; Mouchtouri et al., 2010). The U.S. Environmental Protection Agency (EPA) AP42 provides guidance on drift emissions based on measurements performed in the 1980s and 1990s. AP42 acknowledges a conservative calculation of emissions, and considers all emissions as PM₁₀, citing a lack of clear methodologies for accurately measuring both wet and dry tower emissions and characterizing the PM_{2.5} fraction (EPA-AP42, 1995, p. 42).

A number of methods have previously been employed to characterize drift emissions. Comprehensive reviews of available characterization methods have found that while some methods do well in certain regards and under certain circumstances, no definitive method is suited to all ranges of conditions (Golay et al., 1986; Kinsey, 1991). Broadly, these methods may be categorized into those that measure elemental flux and those that measure droplet size distribution (Kinsey, 1991). Liquid water flux can be measured using thermodynamic methods employing calorimeters or heated psychrometers to measure total liquid water output. Several methods rely on collection of spray drift residue using impingers or cyclone separators to provide an insight into overall drift mass flux by comparing measured mineral flux against tower water composition. Drift emissions have also been characterized using addition of tracer chemical markers to the recirculating water reservoir and monitoring the tracer over time (Campbell, 1969; Lucas et al., 2012). Such methods allow determination of total drift while avoiding the issue of differentiating tower emissions from ambient particles. In general, mineral flux methods excel in high water emission

conditions, but exhibit poor performance and higher uncertainty with the lower water emissions that are increasingly common with the use of modern drift eliminators (Golay et al., 1986). These methods have varying degrees of effectiveness depending on droplet size, require collection of significant material per sample, and do not preserve information on drift droplet size distribution, which is necessary to determine particle transport and deposition (Golay et al., 1986; Kinsey, 1991; Roffman and Van Vleck, 1974).

A second class of measurements characterize emissions by counting spray drift droplets and using water composition data to predict total drift emission as well as dried aerosol emission diameters. Sensitive paper methods to detect droplet impactions have been used for many years and have benefitted from advances in digital image processing to increase throughput (Ruiz et al., 2013), but require high sampling numbers to achieve sufficient statistics and are limited to short sampling times to prevent saturation of the sensitive surface. Sensitive surface methods also require droplet impaction to collect samples, necessitating disruption of the aerosol stream (Golay et al., 1986). Microphotography and laser scattering techniques have been used to determine droplet size distribution optically and have potential to provide time resolution but are subject to interference from droplet coincidence at high concentrations and have accuracy and droplet size limitations (Kinsey, 1991). In general, droplet counting methods excel in lower water loading scenarios (Golay et al., 1986). All counting methods require large amounts of data collection to achieve satisfactory statistics, and may be prone to error for droplet sizes that are not as abundant. While these techniques provide valuable information regarding droplet number concentration and size distribution, small errors in measurement of droplet diameter can result in large errors in calculation of total drift mass flux (Kinsey, 1991). Additionally, droplet-based methods are largely unable to distinguish between spray drift and condensation formed as saturated air exits the tower (Kinsey, 1991; Ruiz et al., 2013).

In order to directly measure cooling tower emissions, we constructed an instrument package and suspended it directly above active cooling towers. Direct measurement of tower emissions allows emission characterization and collection while minimizing the effect of dilution, the difficulties with plume tracking and the need for data extrapolation. Subsequent papers will report the results of these measurements at individual power plant cooling towers.


2 Methods

2.1 System Components

A chassis was constructed of aluminum channel extrusion, built as an open frame to minimize disruption of air flow from the cooling tower exit. A sampling region at one end of the instrument chassis contains the aerosol sampling inlets, (Figure 1, Item 3), a phase Doppler interferometer (PDI) (Figure 1, Item 2), an updraft anemometer, (Figure 1, Item 1), and a temperature and humidity probe, (Figure 1, Item 5). Dried spray drift is sampled by drawing emissions through drying columns (Figure 1, Item 4) and subsequently distributing it to instrumentation for real-


time size analysis as well as collecting filter-based samples using Interagency Monitoring of Protected Visual
75 Environments (IMPROVE) PM samplers. Emissions are sampled by lifting the instrument package with a crane
and suspending it ~1 m over the top of the tower stack. Figure 1 shows the aerosol sampling train and sensors in
the implementation used to characterize tower samples. Figure 2 shows the instrument package suspended above
a cooling tower for sampling.

1. Updraft Anemometer
2. Phase Doppler Interferometer
3. Inlet Nozzles
4. Nafion Dryers
5. Plume Temperature and Humidity Probe
6. Dried Aerosol Manifold
7. Aerodynamic Particle Sizer
8. Dusttrak
9. IMPROVE PM₁₀ Sampler
10. IMPROVE PM_{2.5} Sampler
11. IMPROVE Controller
12. IMPROVE Pumps
13. Dried Aerosol RH Probe
14. HEPA Filters
15. Flow Control Pump
16. Flow Meter
17. PDI Electronics
18. Electronics Enclosure

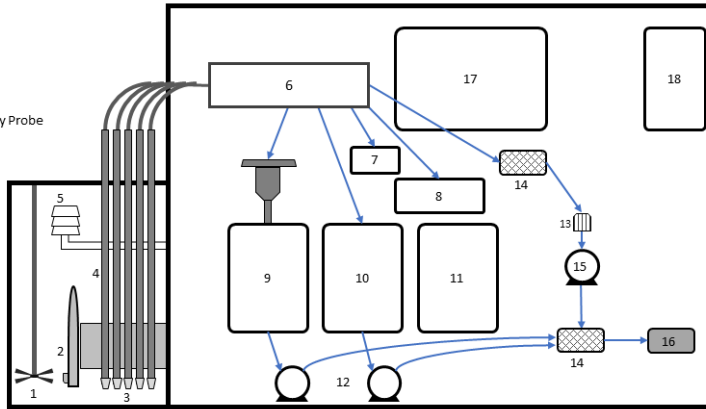

a.

1. Updraft Anemometer
2. Phase Doppler Interferometer
3. Inlet Nozzles
4. Nafion Dryers
5. Plume Temperature and Humidity Probe
6. Dried Aerosol Manifold
7. Aerodynamic Particle Sizer
8. Dusttrak
9. IMPROVE PM₁₀ Sampler
10. IMPROVE PM_{2.5} Sampler
11. IMPROVE Controller
12. IMPROVE Pumps
13. Dried Aerosol RH Probe
14. HEPA Filters
15. Flow Control Pump
16. Flow Meter
17. PDI Electronics
18. Electronics Enclosure

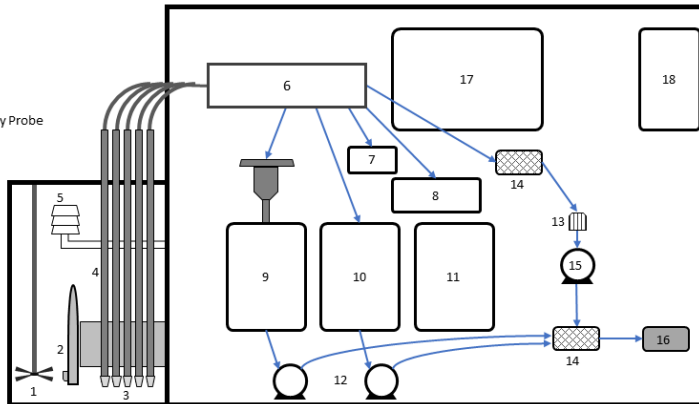

a.

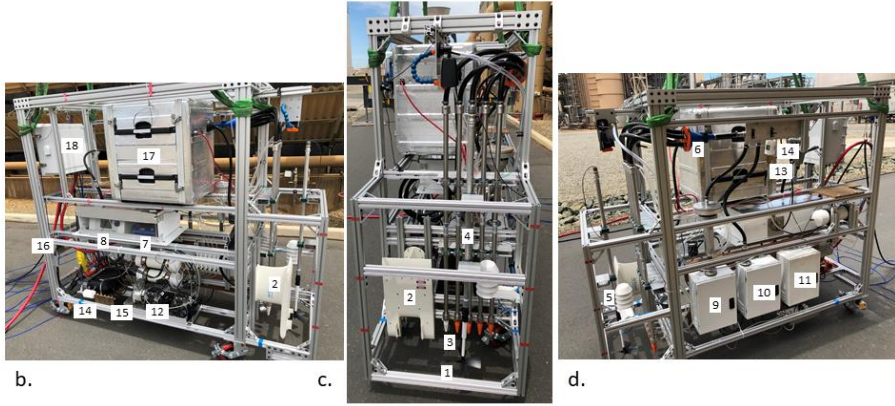


Figure 1. Sampling Instrumentation package a) diagram, b) right side, c) sampling end, d) left side



Figure 2. Instrument package in place above a cooling tower

85 2.1.1 Liquid Droplet Characterization

A phase Doppler interferometer flight probe (Artium Technologies Inc, Sunnyvale, CA) ([Figure 1, Item 2](#)) was mounted at the sampling end of the chassis ~~to count and size liquid droplets emitted. The PDI electronics are housed in a protective enclosure (Figure 1, Item 17) covered in reflective material (to deflect sunlight) and ventilated with dry sheath air from the tower (Figure 1, item 2).~~ Droplets passing through the PDI beam intersection result in phase shifts between multiple detector pairs which are used ~~drying system~~ to precisely determine droplet velocity and diameter, ~~remove excess moisture.~~ This dual-range PDI directly measures drop size and velocity for drops in the range of 2 - 2000 μm (diameter) and provides droplet, from which the drop size and velocity distribution can be derived (Bachalo, 2000). ~~To derive population-level statistics such as number concentration and liquid water content, we use the method described by (Chuang et al., 2008).~~

The PDI instrument makes measurements of individual droplets passing through the detection region using a system of lasers and detectors. The detection region is the intersection volume of two identical laser beams, generating a pattern of constructive and destructive interference. A droplet passing through the detection region acts as a lens and projects into space an image of the interference pattern. The detectors measure the magnification of the interference pattern, from which the droplet diameter is precisely determined (Bachalo and Houser, 1984). Droplet velocity perpendicular to the detection plane is measured with high accuracy from the frequency of the signal collected by any one of the detectors using the well-known laser Doppler velocimetry technique.

To derive population-level statistics such as number concentration and liquid water content, accurate estimates of the volume of air sampled by a PDI is required. The volume of air sampled over a given time interval can be defined as the product of the mean air speed of the flow and the cross-sectional area of the detection region. The mean air speed of the flow is determined by averaging the velocity of individual droplets measured over the time interval. The cross-sectional area is determined by analyzing all detected drops in a given droplet size range and fitting observations to theoretical prediction (a more in-depth description of the method can be found in Chuang et al., 2008).


The PDI measurements are subject to a number of sources of uncertainty. The first is the uncertainty of the inferred diameter of any individual droplet, which is estimated from laboratory calibrations to be less than 1 μm , and is not a strong contributor to overall uncertainty. The second is uncertainty in the probe volume, which determines the sampling rate of the instrument in units of volume of air per unit time. We estimate the uncertainty to be about 5 to 10% (see Chuang et al., 2008, for details), with lower values at large drop sizes, and higher values at smaller drop sizes. The third is statistical counting uncertainty, which arises because the number of drops detected in any given

time interval is subject to randomness-Poisson distributed. We estimate the magnitude of this uncertainty using the well-known formula: for n droplets counted, then the uncertainty in this count is \sqrt{n} . If the number of drops counted is more than 10^2 , then the relative uncertainty is less than 10%. PDI electronics are housed in a protective enclosure covered in reflective material to reject solar heat. A low flow of spent sheath air from the drying system is used to remove moisture from the enclosure, and decreases to less than 3% for greater than 10^3 occurrences. Typical data rates observed over cooling towers are on the order of 10 droplets per second. Therefore, sampling for a period of 2 min would result in a statistical counting uncertainty less than 3%. Typical sampling times are 5 min to a few hours. Thus, the overall uncertainty is dominated by uncertainty in our estimate of probe volume. Therefore, total uncertainty in reported population-level statistics is similar in magnitude to uncertainty in our estimate of probe volume, on the order of 5 to 10%.

2.1.2 Dried Aerosol Characterization

Dried aerosol is drawn through dryers and then distributed to various sampling instruments. Tower updraft velocity is monitored by a Model 21706T Updraft Propeller Anemometer (R.M. Young Company, Traverse City, MI) (Figure 1, Item 1) mounted at the sampling end of the instrument at the same height as the PDI and dryer inlet nozzles (Figure 1, item 1, Item 3). A variable speed oil-less piston pump (Figure 1, item 15) is used to control total instrument flow in order to match the vertical component of the spray drift as it is drawn into the Nafion dryers (Figure 1, item 4). Total volume flow in the system is calculated by combining and filtering the exhaust of the three main pumps driving flow in the sampling system (IMPROVE PM_{2.5}, IMPROVE PM₁₀, and variable speed flow control pump) and measuring the combined volume flow using a mass flow meter (model 4100, TSI Incorporated, Shoreview, MN) (Figure 1, item 16). Static values of 5 lpm and 1 lpm respectively are added to account for the APS and Dusttrak flow rates. Volume flow rate is converted to inlet nozzle velocity based on the diameter of the inlet nozzles installed. The feedback loop for matching the vertical component of updraft velocity while sampling is shown in Figure 3. An overpressure relief valve was included in the exhaust line to prevent accidental overpressurization of the flow meter.

Formatted: Not Superscript/ Subscript

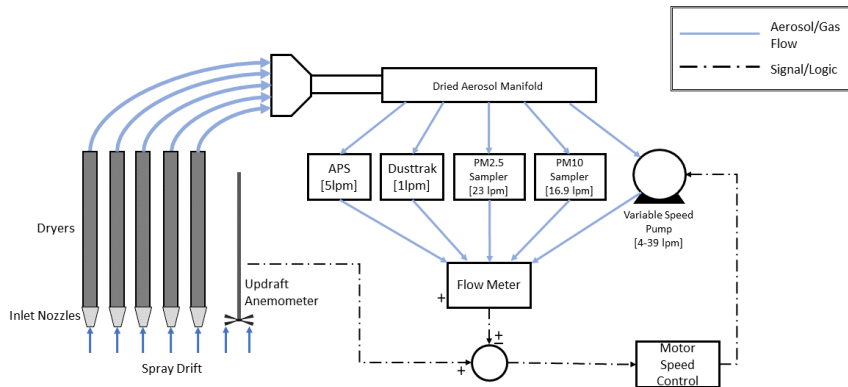

145 **Figure 3. Feedback control for matching vertical updraft velocity**

A feedback algorithm was implemented using an on-board microcontroller to minimize error between calculated nozzle inlet velocity and measured updraft velocity by changing the speed of the flow control pump. Flow rates of between 50-85 lpm are achievable with this method. Installation of inlet nozzles of different diameters allows an adjustment to the range of inlet velocities that corresponded to this flow range (Table 1)-). calculated based on the inlet area of the five nozzles configured in parallel.

150

Nozzle Diameter, mm	Achievable Updraft Velocity, m/s
4.2	12.0 - 20.4
4.9	9.0 - 15.3
5.5	7.0 - 11.9
5.9	6.0 - 10.2
7.3	4.0 - 6.8

Table 1. Inlet nozzle diameters vs. nozzle velocity range

155

In order to characterize dry emissions while sampling at the tower exit, spray drift must be dried while preserving particle suspension. To emulate natural ambient drying, wet tower emissions are drawn in through a bank of Nafion tubing dryers (model MD-700, Perma Pure, Toms River, NJ) located at the sampling end of the frame (Figure 1, Item 4). Each dryer consists of a central tube conducting sample aerosol surrounded by a counter-flow of dry

- Formatted: Font: Times New Roman
- Formatted: Bibliography
- Formatted: Not All caps
- Formatted: Left, Keep with next
- Formatted Table
- Formatted: Left, Indent: Left: -0.01", Keep with next
- Formatted: Left, Keep with next
- Formatted: Left, Keep with next
- Formatted: Left, Keep with next
- Formatted: Left, Keep with next
- Formatted: Left, Keep with next
- Formatted: Left
- Formatted: Left, Indent: Left: 0.5", Hanging: 0.06", Keep with next

instrument-grade sheath air flowing at a minimum of twice the flow rate of the sample air. The two flows are separated by a Nafion membrane, allowing diffusion of water from the sample air into the sheath air without heating or diluting the aerosol sample. The bank of five 48-inch (122 cm) long dryers is operated in parallel to maintain an aerosol flow rate less than 16.7 lpm per dryer, which is the design maximum flow rate for the MD-700. Dry sheath air to each Nafion dryer is controlled using a variable area flowmeter. Figure 4 depicts a single MD-700 dryer configuration.

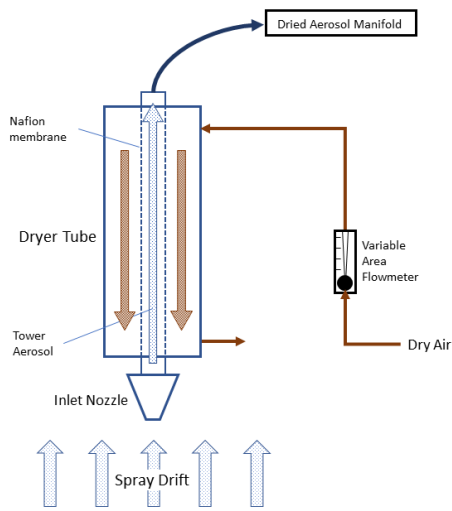


Figure 4. Configuration for a single MD-700 dryer

A calculation of droplet drying capacity was performed using the method described by Hinds (Hinds, 1999). Initial PDI testing detected maximum droplet sizes of approximately 100 μm exiting the tower. Relative humidity (RH) downstream of the dryers was measured directly, and was approximately 60%. If the 1.2 m Nafion dryer tubes are considered to have a linear humidity drop from saturation at the inlet to 60% RH at the outlet, the calculation can be performed using an average of 80% RH in the dryer. At maximum design flow rate, aerosol has a residence time of 5 seconds in each drying tube. This is sufficient time to completely dry droplets as large as 119 μm by the time they exit the dryers. An additional 0.6 m of 19 mm conductive tubing downstream of the Nafion dryers has additional drying potential.

Droplet shattering within the drying tubes was also considered, since this phenomenon would result in large drift droplets being characterized as multiple small droplets. The ratio of the surface energy to the kinetic energy of

Formatted: Indent: Left: 0", Don't keep with next

Formatted: Font: Times New Roman

Formatted: Indent: Left: 0"

moving water drops was calculated for droplets from 1-100 μm and for velocities from 1-10 m/s (Pruppacher and Klett, 2012). All ratios were at least 10x larger than the critical value at which substantial breakup occurs, meaning droplet shattering is not expected.

180

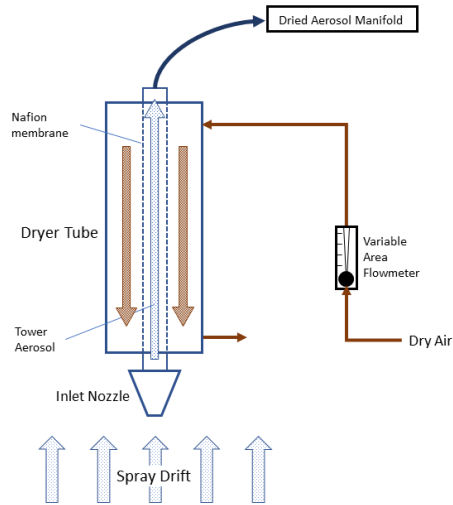


Figure 4. Configuration for a single MD-700 dryer

Formatted: Indent: Left: 0", Don't keep with next

Dry filtered air for the MD-700 sheath is generated on-site using an oil-less piston compressor (model 7HDD-57-M750X, Gast Manufacturing, Inc, Benton Harbor, MI), an air-cooled aftercooler, and a refrigerated-type compressed air dryer (model Krad-15, Keltec Technolab, Twinsburg, OH), generating approximately 170 lpm of 0.1 μm filtered air with a dew point of -16C. Figure 5 shows the dry air generation system. The air is then regulated to 10 psig (~70 kPa gauge) and supplied to the MD-700 driers on the aloft instrument via a 1 inch (25 mm) diameter 150 ft (46 m) umbilical hose. The hose is attached to the instrument chassis via a strain relief, and is also strain relieved at the supply end near the dryer connection. The dry air is split into 5 separate flows for each of the Nafion dryer sheath air paths via a bank of variable area flowmeters.

185

190

Formatted: Font: Times New Roman

Formatted: Indent: Left: 0"



Figure 5. Dry air generation equipment including compressor, aftercooler, dryer, regulator, and umbilical hose.

195

Dried aerosol is then drawn to a manifold feeding a number of instruments (Figure 1, [itemItem 6](#)). Grounded static dissipative tubing and lining are used to minimize particle loss due to accumulated surface charge. An aerodynamic particle sizer (APS) (Model 3321, TSI Incorporated, Shoreview, MN) is used for primary dry aerosol size and number quantification (Figure 1, [itemItem 7](#)). A DustTrak (Model 8533, TSI Incorporated, Shoreview, MN) provides auxiliary characterization of particle size and concentration (Figure 1, [itemItem 8](#)). A water-tight enclosure protects both instruments from liquid damage. A low-power notebook computer ([Acer Travelmate Spin B1](#)) is used to log data and remotely begin and end sampling for both instruments.

200

Dried aerosol samples are also collected from the manifold using a pair of [Interagency Monitoring of Protected Visual Environments \(IMPROVE\)](#) sampler modules. A PM_{2.5} module (Figure 1, [itemItem 10](#)) collects sample at a rate of 23 lpm and a PM₁₀ module (Figure 1, [itemItem 9](#)) with the sampling head modified for in-line flow collects sample at 16.9 lpm. [Dedicated vacuum pumps \(Figure 1, Item 12\) draw flow through each IMPROVE sampler.](#) Each sampler module contains four filter positions loaded with pre-weighed 25mm PTFE filters (Pall Teflo 3 µm, Pall Corporation, Port Washington, NY). Particulate matter gathered on these filters is subsequently analyzed gravimetrically and by X-ray fluorescence (XRF) to determine mass and elemental composition ([IMPROVE, 2020a, 2020b, 2017](#)), ([IMPROVE, 2020a, 2020b, 2017](#)). An IMPROVE control module (Figure 1, [itemItem 11](#)) connected to both modules monitors sampling flow rates and is used to remotely start and stop the samplers over a cellular data connection.

205

210

2.2 Data Logging and Telemetry

Vital metrics are recorded using a custom electronics package based on a ruggedized version of an Arduino microcontroller (Rugged Mega, Rugged Circuits, MI) mounted on the aloft instrument (Figure 1, [item 18](#)).

Updraft velocity, aerosol flow rate, dried aerosol temperature and humidity, and tower plume temperature and humidity are recorded to a local SD card and transmitted to a computer on the ground in real time. A 2.4 GHz Zigbee wireless connection is used to transmit data to a ground computer and to receive commands from the ground to start or stop sampling and adjust pump parameters. Custom code developed in LabView receives, parses, and logs data from the aloft instrument, and allows remote control of flow and sampling state.

A local positioning system (model MDEK1001, Decawave Limited) is used to assist with precise and repeatable positioning of the aloft instrument rack. Four fixed anchor nodes are placed on the top deck of the cooling tower. A fifth sensor is mounted to the sampling end of the instrument, and relayed position data via serial output. Scale markers were also painted on the instrument chassis at 12-inch intervals for visual reference relative to tower features. A wireless camera (Casacam VS1001) was installed above the sampling end of the instrument to provide a direct view of the sampler's position relative to the tower. Once the instrument is positioned in the desired location, two guy ropes are used to secure the instrument package to the tower structure to prevent unwanted motion due to air currents acting on the assembly. Once tethered, the instrument package is constrained to approximately 0.3 m of travel.

Tower plume temperature and humidity are continuously monitored by a probe mounted in the sampling end of the chassis (model HMS112, Vaisala Inc, Louisville, CO). Dried aerosol temperature and humidity is monitored by an additional probe (model 657C-1, Dwyer Instruments, Michigan City, IN) (Figure 1, [item 13](#)) placed downstream of a HEPA filter (model HC10-4N-PTF, Aerocolloid LLC, Minneapolis, MN) (Figure 1, [item 14](#)) to protect the probe from contaminants. The humidity probe is positioned between the dry aerosol manifold and the flow control pump so that the probe does not affect aerosol being sampled by other instrumentation.

2.3 Environmental Considerations

The instrument package is required to operate in a variety of industrial environments, including electrically noisy environments, operation in heat and direct sunlight, and exposure to a constant upward flow of high humidity and water spray. To minimize potential impacts of electrical noise, analog sensor readings are transmitted as 4-20 ma current loop signals where possible. These signals are converted to digital and subsequently recorded by the microcontroller.

Sensitive instrumentation and electrical connections throughout the instrument package are housed in watertight enclosures. Where additional cooling is necessary, spent dry air from the Nafion dryer sheaths is directed to electrical enclosures to cool instrumentation before exhausting to the environment. Exhaust air from the motor

245 control pump is expelled through a row of small air jets, positioned to deflect and remove droplets from the camera
lens in order to maintain visibility. Instrumentation and connections that do not require additional cooling air are
enclosed with desiccant packs as an additional precaution. Wireless temperature and humidity probes (Thermopro
TP65), are placed in electronics enclosures to provide real time indication of equipment conditions to operators on
the ground.

250

2.4 Ambient Sampling

To differentiate between spray-drift-based emissions and ambient aerosol passing through the tower, a parallel set
of measurements are made adjacent to the tower. An instrument package including an APS, Dusttrak, IMPROVE
PM_{2.5} and PM₁₀ samplers is operated concurrently with aloft sampling. Sampling inlets at the ambient sampling
255 station are located at a height of 2 meters. The parallel sampling location is approximately 30m from the tower, and
is chosen to be representative of the intake of the cooling tower while maintaining a distance from the generator
and crane. Ambient temperature and humidity are continuously recorded using a model HL-1D data logger
(Rotronic AG, Bassersdorf, Switzerland). Wind speed and direction near the tower are logged to a local SD card
on a microcontroller attached to a battery-powered sonic anemometer (Model 81000, RM Young Company,
260 Traverse City, MI).

2.5 Power

Power for operating ground and aloft instruments is generated on-site using a 1000 W propane-powered generator.
A dual-tank switching regulator allows the propane tanks to be exchanged without interrupting sampling. Generator
exhaust is cooled via dilution with ambient air drawn in through an in-line blower (model FR110, Fantech, Lenexa,
265 KS) and then HEPA filtered (model CFB-HP-6, HVACQuick, Medford, OR) prior to release to prevent contamination
of sample aerosol at the site. A temperature probe is mounted in the dilute exhaust stream to ensure that exhaust
gases do not damage the filter. The generator is positioned approximately 100 feet (30 m) from the ground sampling
station and cooling cell, as shown in Figure 6. Power is delivered to the ground and aloft instruments via a 150 ft
(46 m) supply umbilical, strain relieved near either end to the instrument chassis and to a stationary block near the
270 generator.

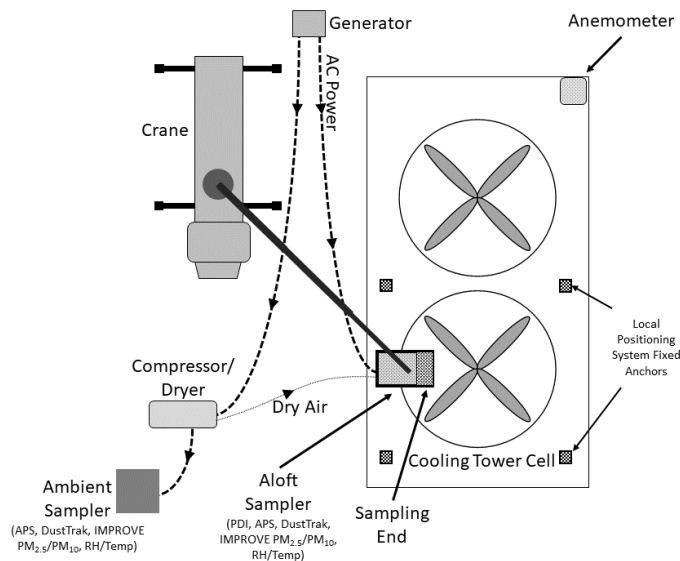


Figure 6. Typical deployment for tower sampling (view is from above)

2.6 Additional Considerations

275 Due to the nature of the sampling method, it is critical that no equipment or components could fall from the crane
 or instrument chassis due to the risk of damage to the plant facility. All equipment on the instrument platform is
 redundantly secured. Components that can potentially fall if one or two fasteners fail are secured with tether cables
 as an additional precaution.

280 The complete instrument weighs approximately 800 lbs (~360 kg). It is fitted with shock-absorbing locking
 casters and can be moved on level ground by one or two people. All supplemental field equipment, including
 sampling equipment, compressors, dryers, generators, and exhaust filtration is mounted on carts or otherwise
 easily portable for field deployment.

2.7 Sampling Validation

285 Aloft and ground IMPROVE samplers and APS's were run in parallel in a collocated study within a well-mixed room
 to determine sampling differences. Gravimetric results are shown in Table 2. The discrepancy in collection of larger

PM is presumed to be due to losses within the aloft sampling train. APS instrument variability was observed both with the entire aloft sampling train in place and with bare APS instruments placed side-by-side. To account for this variation, collocated samples were taken before and after each field sampling day, in which the two APS units were allowed to run with the aloft instrument placed on the ground near the ground sampling station. Data from the aloft APS was normalized to the ground APS for each site based on this collocation period. Normalization was applied for size ranges below 12 μm . A discrepancy was seen for particles larger than 12 μm that were likely lost to impaction on the way to the APS. Therefore, data for this size range is not reported. In addition, aloft APS data was normalized to ground data to account for line losses leading to the aloft APS, which were characterized during the extended ground collocation test.

TEST 1	PM _{2.5} [$\mu\text{g} + \text{uncertainty}$] [$\mu\text{g}/\text{m}^3$]	PM ₁₀ [$\mu\text{g} + \text{uncertainty}$] [$\mu\text{g}/\text{m}^3$]	Coarse (PM ₁₀ - PM _{2.5}) [$\mu\text{g} + \text{uncertainty}$] [$\mu\text{g}/\text{m}^3$]
ALOFT INSTRUMENT	8.939 + 0.1	11.444 + 0.2	2.485 + 0.3
GROUND INSTRUMENT	8.939 + 0.1	12.040 + 0.2	3.091 + 0.3
TEST 2	PM _{2.5} [$\mu\text{g} + \text{uncertainty}$] [$\mu\text{g}/\text{m}^3$]	PM ₁₀ [$\mu\text{g} + \text{uncertainty}$] [$\mu\text{g}/\text{m}^3$]	Coarse (PM ₁₀ - PM _{2.5}) [$\mu\text{g} + \text{uncertainty}$] [$\mu\text{g}/\text{m}^3$]
ALOFT INSTRUMENT	12.242 + 0.1	15.545 + 0.2	3.303 + 0.3
GROUND INSTRUMENT	12.222 + 0.1	16.441 + 0.2	3.929 + 0.3

Table 2. Gravimetric results from IMPROVE sampler collocation. Coarse PM_{coarse} is calculated as the difference between PM₁₀ and PM_{2.5}

3 Discussion

A number of previous methods have been used to characterize cooling tower emissions. Ultimately, tower emissions characterization is concerned with measuring the aerosol that leaves the facility and enters the environment or settles to the ground – in the case of wet cooling towers, this takes the form of dried aerosol composed of the contents of spray drift droplets. However, all techniques used in measurement of cooling tower emissions characterize liquid droplets escaping the tower rather than the eventual dry aerosol. Ambient and fence line monitoring techniques such as those applied to refinery emissions sample aerosol that is realistically aged and actually leaves the facility, but can only characterize small portions of overall emissions and cannot easily be related to total emissions without knowing how dilute the aerosol has become as it mixes with the environment. Attempts to correct for ground sampling dilution have resulted in order-of-magnitude discrepancies (Roffman and Van Vleck,

Formatted: Font: Not Bold, Not All caps

Formatted Table

Formatted: Font: Not Bold, Subscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Subscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Subscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Subscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Centered

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Superscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Superscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Font: Not Bold, Superscript, Not All caps

Formatted: Font: Not Bold, Not All caps

Formatted: Centered

Formatted: Subscript

Formatted: Subscript

Formatted: Subscript

Formatted: Subscript

Formatted: Superscript

Formatted: Superscript

Formatted: Superscript

Formatted: Left

Formatted: Subscript

Formatted: Subscript

1974). Direct sampling above the tower in conjunction with use of an on-board aerosol drying system allows direct characterization of dried aerosol, without unknown levels of dilution from mixing with ambient air. Rapid drying of spray drift mimics environmental drying while preserving dry aerosol size distribution, in contrast to bulk droplet collection methods such as heated glass bead sampling. This size preservation allows size-segregated sampling of dried aerosol into coarse and fine ranges for collection and subsequent analysis with IMPROVE PM_{2.5} and PM₁₀ modules. Pre-drying also enabled detailed dried aerosol size characterization using real-time instrumentation such as the APS, which provides size characterization between 0.5 µm to 12 µm. This combination allows direct characterization of aerosol that ultimately is emitted to the environment, and eliminates false signal from water droplets formed by re-condensation of saturated air exiting the tower rather than spray drift. In contrast, existing methods that characterize emissions based on droplet counts, including sensitive surface and optical methods, are all subject to this issue. The APS completes each sample analysis in approximately one minute, while longer sampling times are required for bulk sample collection using IMPROVE samplers and filters to collect sufficient mass for analysis.

In conjunction with multiple characterizations of dried aerosol, drift droplets are characterized with a PDI, which offers high accuracy, time resolved data. The PDI characterizes liquid droplets without disturbing the aerosol flow as it exits the tower, and operates with less than 10% relative size uncertainty over a range of 2 µm to 2mm. The PDI provides higher accuracy than previous light scattering methods, particularly in smaller droplet size ranges (Bachalo, 2000). These instruments provide rapid characterization, requiring as little as 5 minutes of sampling at a single location above the tower to obtain a statistically significant sample size.

Specific instrumentation chosen for the instrument package, including the PDI and APS, allow high resolution size characterization compared to methods based on scattering, photography, or sensitive paper. Use of IMPROVE samplers for size-selected sample collection allows a distinction between coarse and fine particles when analyzing for total mass as well as composition. On-board rapid droplet drying preserves the aerosol size distribution enabling thorough characterization of dried emissions, while avoiding issues of false sampling of re-condensation that affect many other droplet sampling methods. Use of multiple sampling modalities (i.e. droplet, dried aerosol, optical, and elemental analysis) provides a range of analytical strengths not available with the prior sampling techniques outlined above.

335 **4 Conclusion**

Spray drift emissions are difficult to accurately characterize for a number of reasons, and past attempts have not resulted in a definitive method. Direct sampling from the tower exit combined with rapid heatless drying enables representative sampling while preserving aerosol properties such as size distribution. Inclusion of modern instrumentation in the sampler package allows enhanced measurement precision compared to past techniques,

340 and size-resolved collection of dried aerosol enables separate analysis of PM_{2.5} and PM₁₀ mass emissions and
chemical composition. The instrumentation described here is designed for characterization of wet cooling tower
emissions, but is also suitable for measurement of droplet-, aerosol- or gas-based emissions from a variety of
sources. The instrument rack configured with different instruments could, in general, be used to measure emissions
from any stack.

345

Acknowledgement

This work was supported by California Energy Commission contract EPC-16-040.

References

- 350 Bachalo, W., 2000. Spray diagnostics for the twenty-first century. *Atomization and Sprays* 10, 439–474.
Bachalo, W.D., Houser, M.J., 1984. Phase/Doppler spray analyzer for simultaneous measurements of drop size
and velocity distributions. *Optical Engineering* 23, 235583.
- Campbell, J., 1969. Review of CTI work on the measurement of cooling tower drift loss.
Chuang, P.Y., Saw, E.W., Small, J.D., Shaw, R.A., Sipperley, C.M., Payne, G.A., Bachalo, W.D., 2008. Airborne
355 Phase Doppler Interferometry for Cloud Microphysical Measurements. *Aerosol Science and Technology*
42, 685–703. <https://doi.org/10.1080/02786820802232956>
- EPA-AP42, U., 1995. Environmental Protection Agency,(1995). Compilation of Air Pollutant.
Golay, M., Glantschnig, W., Best, F., 1986. Comparison of methods for measurement of cooling tower drift.
Atmospheric Environment (1967) 20, 269–291.
- 360 Hinds, W.C., 1999. Aerosol technology: properties, behavior, and measurement of airborne particles. John Wiley
& Sons.
- IMPROVE, 2020a. IMPROVE-SOP-251_Sample-Handling-2020_FINAL_signed.pdf [WWW Document].
IMPROVE SOP-251 Sample Handling. URL—[http://vista.cira.colostate.edu/improve/wp-](http://vista.cira.colostate.edu/improve/wp-content/uploads/2020/07/IMPROVE-SOP-251_Sample-Handling-2020_FINAL_signed.pdf)
365 [content/uploads/2020/07/IMPROVE-SOP-251_Sample-Handling-2020_FINAL_signed.pdf](https://airquality.ucdavis.edu/improve-documentation)URL
<https://airquality.ucdavis.edu/improve-documentation> (accessed 10.16.20).
- IMPROVE, 2020b. IMPROVE SOP 351_Data Processing and Validation_2020final_srs_signed.pdf [WWW
Document]. IMPROVE SOP-351 Data Processing and Validation. URL
[https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20351_Data%20Processing%20and%20Validation_2020final_srs_signed.pdf)
370 [files/IMPROVE%20SOP%20351_Data%20Processing%20and%20Validation_2020final_srs_signed.pdf](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20351_Data%20Processing%20and%20Validation_2020final_srs_signed.pdf)
[improve-documentation](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20351_Data%20Processing%20and%20Validation_2020final_srs_signed.pdf) (accessed 11.18.20).
- IMPROVE, 2017. IMPROVE SOP 301_XRF Analysis of Aerosol Deposits on PTFE Filters_12.2017.pdf [WWW
Document]. IMPROVE SOP-301 XRF Analysis of Aerosol Deposits on PTFE Filters. URL
[https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20301_XRF%20Analysis%20of%20Aerosol%20Deposits%20on%20PTFE%20Filters_12.2017.pdf)
375 [files/IMPROVE%20SOP%20301_XRF%20Analysis%20of%20Aerosol%20Deposits%20on%20PTFE%20](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20301_XRF%20Analysis%20of%20Aerosol%20Deposits%20on%20PTFE%20Filters_12.2017.pdf)
[Filters_12.2017.pdf](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20301_XRF%20Analysis%20of%20Aerosol%20Deposits%20on%20PTFE%20Filters_12.2017.pdf)[improve-documentation](https://airquality.ucdavis.edu/sites/g/files/dgvnsk1671/files/inline-files/IMPROVE%20SOP%20301_XRF%20Analysis%20of%20Aerosol%20Deposits%20on%20PTFE%20Filters_12.2017.pdf) (accessed 11.18.20).
- Kinsey, J.S., 1991. Development of Particular Emission Factors for Wet Cooling Towers (No. EPA Contract No.
68-DO-0137). Midwest Research Institute, Kansas City, MO.

- Lucas, M., Martinez, P., Viedma, A., 2012. Experimental determination of drift loss from a cooling tower with different drift eliminators using the chemical balance method. *International journal of refrigeration* 35, 1779–1788.
- 380 Mouchtouri, V.A., Goutziana, G., Kremastinou, J., Hadjichristodoulou, C., 2010. Legionella species colonization in cooling towers: risk factors and assessment of control measures. *American journal of infection control* 38, 50–55.
- 385 Pruppacher, H.R., Klett, J.D., 2012. *Microphysics of Clouds and Precipitation: Reprinted 1980*. Springer Science & Business Media.
- Roffman, A., Van Vleck, L.D., 1974. The state-of-the-art of measuring and predicting cooling tower drift and its deposition. *Journal of the Air Pollution Control Association* 24, 855–859.
- 390 Ruiz, J., Kaiser, A., Ballesta, M., Gil, A., Lucas, M., 2013. Experimental measurement of cooling tower emissions using image processing of sensitive papers. *Atmospheric environment* 69, 170–181.